



4/20/2020

Sprint/Embarq Telephone
Gerry Jones
138 W 6th St.
Junction City, KS 664412939

EL 39755

To Whom It May Concern:

This is to advise you that Evergy is filing an "EL" application with the State Corporation Commission in accordance with the provisions of Kansas Administrative Regulations, article number 12, 82-12-1 thru 82-12-9, effective August 11, 1995, State Of Kansas for approval of plan, specifications, and location of an Electric Power Line.

Your companies facilities may be involved directly with our proposed "Electric Power Facilities" or your company is being notified because your facilities are within one-half (1/2) mile of the proposed Electric Line.

The attached sketch shows the location of our proposed Electric Power Line and your facilities. If there are any questions you may have concerning this Electric Power Line, or any problem regarding coordination of your facilities, we will be very glad to discuss the matter with you.

Please Notify Kansas Corporation Commission, Utilities Division, 1500 SW Arrowhead Road, Topeka, KS 66604-4027 and us of any objection that you may have to this proposed Electric Power Line within 10 days (Railroad 15).

Any questions concerning this application, please contact Pam Finnegan +1 (913) 758-2772 at our Atchison Service Center office, or Scott Pfeiffer - 785-575-6019 at our general office.

Sincerely,

Scott Pfeiffer

Attachment's
IDENTIFICATION INFORMATION

Application Sketch No 31899, Work Request No M101118017 Section(s) 34 T07S R18E located in Jefferson County, Kansas







THE OPERATING CHARACTERISTICS OF THIS POWER LINE ARE TO BE:
7,200 Volts, 1 Phase, 2 Wires.

PHYSICAL PROPERTIES OF ELECTRIC LINE:
Poles - Kind Wood, Height 40' , Class 4 , Conductor - Size 2 , Kind ACSR & CID

Form No. 604-1A
Rev. (8/93)

S.C.C. FORM “EL” Application Sketch


List all public utilities (electric, pipe, railroads, & other facilities) within ½ mile of proposed line

Code	Ownership	Length	OH/UG	#Wires	Kind	Size	Phase	Neut/Shld	Grounded/ Ungrounded	Oper. Volts
A B 	Evergy Proposed	2,205'	OH	2	ACSR	2	1	2 ACSR	Grounded	7,200kV
B C 	Evergy Proposed	220'	UG	1	CID	2	1	N/A	Grounded	7,200kV
	Evergy Proposed								Grounded	7,200kV
XXXXXX	Evergy Removal								Grounded	34,500kV
	Evergy Removal								Grounded	12,470kV
	Evergy Removal								Grounded	7,200kV
	Evergy Proposed								Grounded	12,470kV
	Evergy Proposed								Grounded	12,470kV
	Evergy Proposed								Grounded	12,470kV

Brown-Atchison Electric Coop
Sprint/Embarq Telephone

Evergy proposes to build a new single-phase overhead line with a single-phase underground line for a new residential property at 19394 Effingham Rd, Valley Falls, KS Jefferson County.
T07S R18E Sec. 34

Work Request# M101118017
Application Sketch# 31899
Pam Finnegan

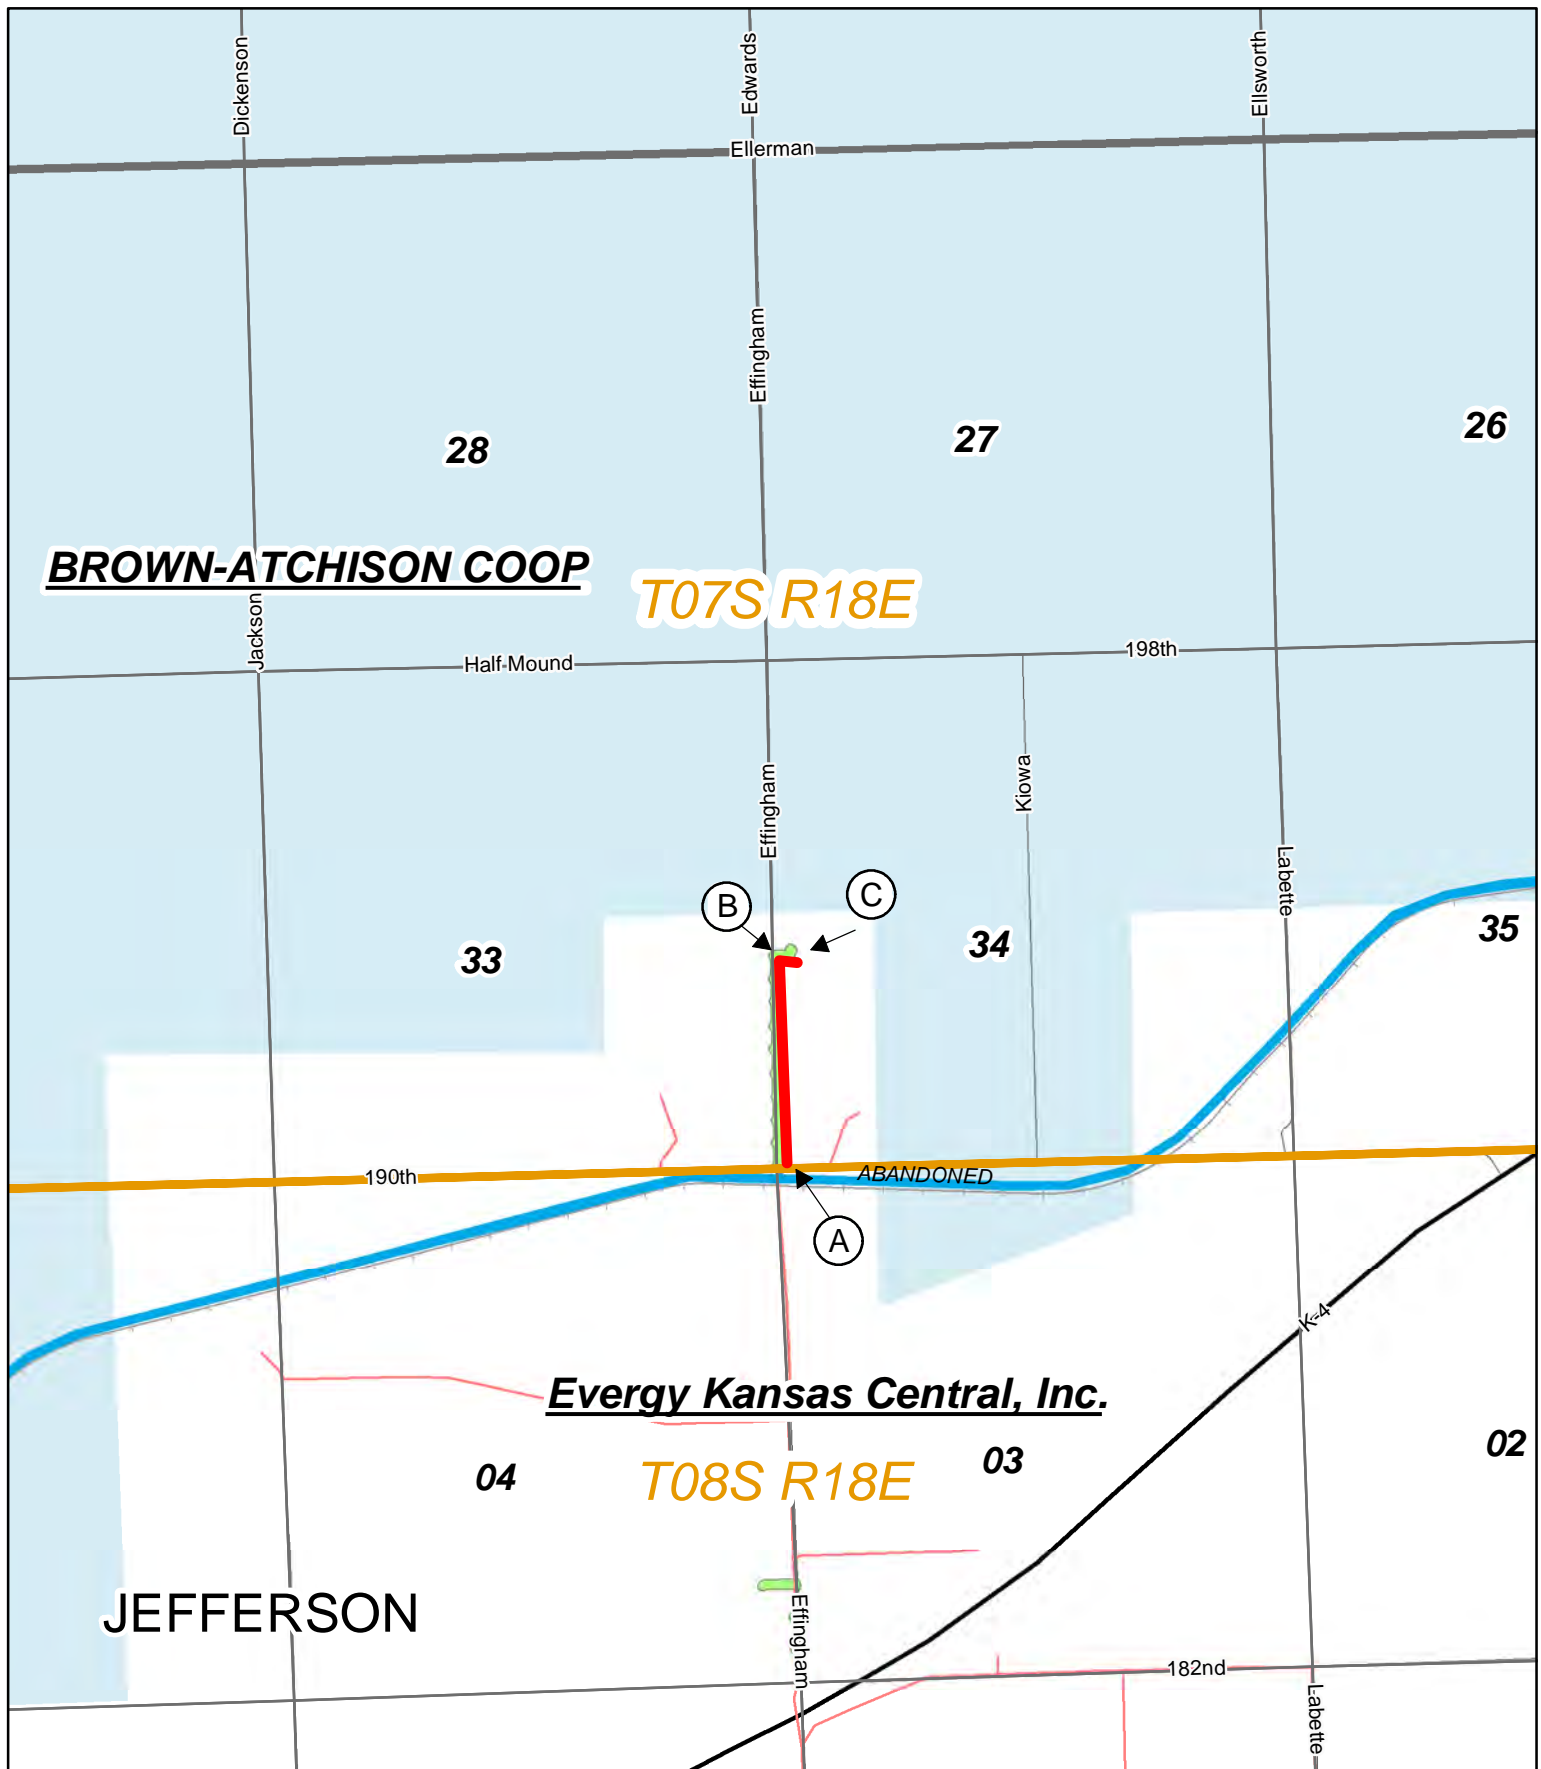

Think Safety!



Overhead Primary Line Extension

BY Pam Finnegan

WR # M101118017

Crew HQ 2401

Date 4/20/2020

Scale 1" = 2,640'

Page 1

Proposed

Application Number 31899



4/20/2020

Brown-Atchison Electric Co-Op
Michele McClaskey
1712 Central Avenue
Horton, KS 664390230

To Whom It May Concern:

This is to advise you that Evergy is filing an "EL" application with the State Corporation Commission in accordance with the provisions of Kansas Administrative Regulations, article number 12, 82-12-1 thru 82-12-9, effective August 11, 1995, State Of Kansas for approval of plan, specifications, and location of an Electric Power Line.

Your companies facilities may be involved directly with our proposed "Electric Power Facilities" or your company is being notified because your facilities are within one-half (1/2) mile of the proposed Electric Line.

The attached sketch shows the location of our proposed Electric Power Line and your facilities. If there are any questions you may have concerning this Electric Power Line, or any problem regarding coordination of your facilities, we will be very glad to discuss the matter with you.

Please Notify Kansas Corporation Commission, Utilities Division, 1500 SW Arrowhead Road, Topeka, KS 66604-4027 and us of any objection that you may have to this proposed Electric Power Line within 10 days (Railroad 15).

Any questions concerning this application, please contact Pam Finnegan +1 (913) 758-2772 at our Atchison Service Center office, or Scott Pfeiffer - 785-575-6019 at our general office.

Sincerely,


Scott Pfeiffer

Attachment's
IDENTIFICATION INFORMATION

Application Sketch No 31899, Work Request No M101118017 Section(s) 34 T07S R18E located in Jefferson County, Kansas

THE OPERATING CHARACTERISTICS OF THIS POWER LINE ARE TO BE:
7,200 Volts, 1 Phase, 2 Wires.

PHYSICAL PROPERTIES OF ELECTRIC LINE:
Poles - Kind Wood, Height 40' , Class 4 , Conductor - Size 2 , Kind ACSR & CID

Evergy proposes to build a new single-phase overhead line with a single-phase underground line for a new residential property at 19394 Effingham Rd, Valley Falls, KS Jefferson County.
T07S R18E Sec. 34

Work Request# M101118017
Application Sketch# 31899
Pam Finnegan

KCC Cost Report

Time run: 4/20/2020 7:03:04 AM

EL 39755

Work Order Number	Tech ID	Location
M101118017	Pam Finnegan	NORTONVILLE

Est Request Num	Est Version Num	Work Order Description
121045	3	Lutz Home 2200'OH 215'UG Extension

FERC Acct	Action	Description	Quantity	Material	Labor	Additional Items	Transportation	OH Cost	Total Cost
3640	INSTALL	Conduit - Underground	10	91.99	98.75	0.00	83.94	220.14	494.82
3640	INSTALL	Pole - Wood - 40 Foot	9	3120.50	2223.10	0.00	1889.64	5520.30	12753.54
3640	INSTALL	Pole - Wood - 45 Foot	1	461.29	680.47	0.00	578.40	911.67	2631.83
3640	REMOVE	Pole - Wood - 35 Foot	1	0.00	645.74	0.00	548.88	1100.36	2294.98
3650	INSTALL	Arrester	1	28.65	17.84	0.00	15.16	46.31	107.96
3650	INSTALL	Conductor - Aluminum	4408	802.26	1395.83	0.00	1186.46	2826.47	6211.02
3650	INSTALL	Switch - Disconnect - 15 Kv	4	345.84	268.95	0.00	228.61	647.58	1490.98
3650	REMOVE	Switch - Disconnect - 15 Kv	2	0.00	124.18	0.00	105.55	211.61	441.34
3662	REMOVE	Conduit - Underground	20	0.00	0.00	0.00	0.00	0.00	0.00
3672	INSTALL	Arrester	1	64.54	0.00	0.00	0.00	35.82	100.36
	INSTALL	DEAD FRONT,LOOP FEED,CONV-A, PRIM:12470Y/7200 SEC:120/240 SIZE: 25 KVA NO TAPS LEGACY TYPEKEY:27112502 WITH PARTIAL RANGE CURRENT LIMITING FUSE(S) NOTE:NEW TRANSFORMERS PURCHASED TO CONFORM TO WESTAR SPECIFICATION 1P-PDMTXFMR, LATEST REVISION	1	1250.43	0.00	0.00	0.00	0.00	1250.43
		DEAD FRONT,LOOP FEED,CONV-A, PRIM:12470Y/7200 SEC:120/240 SIZE: 25 KVA NO TAPS LEGACY TYPEKEY:27112502 WITH PARTIAL RANGE CURRENT LIMITING FUSE(S) NOTE:NEW TRANSFORMERS PURCHASED TO CONFORM TO WESTAR SPECIFICATION 1P-PDMTXFMR, LATEST REVISION	1	1250.43	0.00	0.00	0.00	0.00	1250.43
	INSTALL	Stores Overhead	0	0.00	0.00	0.00	0.00	400.14	400.14
5940002		U/G CONDUCTORS RESD	0	0.00	174.64	0.00	148.44	203.80	526.88
	INSTALL		0	742.84	0.00	0.00	0.00	237.71	980.55
			0	5657.91	0.00	0.00	0.00	0.00	5657.91
		SUBTOTAL	0	13816.68	5629.50	0.00	4785.08	12361.91	36593.17
		CUSTOMER CONTRIBUTION	0	0.00	0.00	0.00	0.00	0.00	0.00
		GRAND TOTAL	0	13816.68	5629.50	0.00	4785.08	12361.91	36593.17

S.C.C. Application Table

EL 39755

WR No. M101118017

Physical Properties of Line,

Pole: Wood Height: 40' Class: 4 Conductor Type: ACSR & CID Size: 2 Average spans: 245 feet

Has clearance been provided for other utilities, Yes: X No:

Application for Primary construction to:	Cost Estimate	Miles of Primary Line	Number of New Customers
New Rural-Domestic	\$36,593.17	0.46 mi	1
New Commercial & Industrial			
New Lines to Improve Service			
New Sub Transmission			
Retirement			
Conversion			
<u>TOTAL</u>	\$36,593.17	0.46 mi	1

For Official Use Only

Plotted _____

Checked by _____

Date
Approved _____

Remarks, Addresses & Etc.

Everygy proposes to build a new single-phase overhead line with a single-phase underground line for a new residential property at 19394 Effingham Rd, Valley Falls, KS Jefferson County.
T07S R18E Sec. 34

Work Request# M101118017
Application Sketch# 31899
Pam Finnegan

Internal Use Only

Form "EL"

BEFORE THE STATE CORPORATION COMMISSION OF THE STATE OF KANSAS

IN THE MATTER OF THE APPLICATION OF

"EL" No. **EL 39755**

Evergy Kansas Central, Inc

Assigned By Commission

Applicant

Appl : 31899

WR # : M101118017

Applicants Identification Number

FOR APPROVAL OF PLANS, SPECIFICATIONS AND LOCATION OF PROPOSED ELECTRIC LINE CONSTRUCTION

Evergy proposes to build a new single-phase overhead line with a single-phase underground line for a new residential property at 19394 Effingham Rd, Valley Falls, KS Jefferson County.
T07S R18E Sec. 34

Work Request# M101118017

Application Sketch# 31899

Pam Finnegan

HERE DESCRIBE THE LOCATION VERY BRIEFLY

COMES NOW EVERGY KANSAS CENTRAL INC.

APPLICATION

Applicant OF KANSAS A Corporation

Topeka, Kansas (Corporation, Partnership, Individual or Municipality)

REQUESTING THE COMMISSION TO APPROVE THE ATTACHED PLANS, SPECIFICATIONS AND LOCATION OF A PROPOSED ELECTRIC LINE, OR CHANGE IN ELECTRIC LINE CONSTRUCTION, LOCATED OUTSIDE THE CORPORATE LIMITS OF ANY CITY, AS SHOWN ON THE ACCOMPANYING MAP AND IS HEREINAFTER MORE FULLY DESCRIBED.

THE OPERATING CHARACTERISTICS OF THIS LINE ARE TO BE:

ELECTRIC 7,200 VOLTS, 1 PHASE, HERTZ, DESIGN LOAD Kw KILOWATTS

PROVIDE CONNECTION (e.g GROUNDE WYE), PHASE TO PHASE VOLTAGE, NUMBER OF CONDUCTORS, AND POINTS OF GROUNDING THE DESCRIPTION OF THE LOCATION AND POINTS BETWEEN WHICH SAID PROPOSED LINE IS TO BE INSTALLED AND OPERATED ARE AS FOLLOWS:

Evergy proposes to build a new single-phase overhead line with a single-phase underground line for a new residential property at 19394 Effingham Rd, Valley Falls, KS Jefferson County.
T07S R18E Sec. 34

Work Request# M101118017

Application Sketch# 31899

Pam Finnegan

as shown on application Sketch No 31899

PHYSICAL PROPERTIES OF LINE:

STRUCTURES:

Poles - Kind Wood, Height 40', Class 4, Conductor Size 2, Kind ACSR & CID, Average Span (ft) 245'AvgSpan

HAS CLEARANCE BEEN PROVIDED FOR OTHER UTILITIES? Yes

Cost Estimate \$36,593.17

NUMBER AND TYPE OF CUSTOMERS Residential

***NOTE: PLEASE USE THE FOLLOWING ABBREVIATIONS FOR PREDOMINANT STRUCTURE KIND:**

SPW-SINGLEPOLE, WOOD

SPF - SINGLEPOLE, FIBERGLASS

TS - TOWER STEEL

SPS-SINGLEPOLE, STEEL

HFW - H-FRAME, WOOD

O - OTHER, PLEASE EXPLAIN

SPC-SINGLEPOLE, CONCRETE

HFS - H-FRAME, STEEL

NA - NOT APPLICABLE

THE FOLLOWING IS A CORRECT LIST OF ALL THE UTILITIES WITHIN 1/2 MILE OF THE PROPOSED LINE. ABSENT A JOINT USE OR OTHER AGREEMENT, ALL UTILITIES LISTED BELOW SHALL BE NOTIFIED IN WRITING AS PROVIDED IN K.A.R 82-12-5, AND A COPY OF THE NOTICE SHALL BE ATTACHED. PLEASE INDICATE THOSE UTILITIES LISTED FOR WHICH A JOINT USE OR OTHER AGREEMENT HAS BEEN MADE WITH AN ASTERISK (*).

Company Name

Brown-Atchison Electric Co-Op
Sprint/Embarq Telephone

Address

1712 Central Avenue, Horton, KS - 664390230
138 W 6th St., Junction City, KS - 664412939

IS THIS LINE WITHIN THE APPLICANTS CERTIFICATE AREA? Yes

APPLICANT FURTHER SHOWS TO THE COMMISSION THAT THE CONSTRUCTION OF SAID PROPOSED LINE SHALL BE THROUGHOUT IN ACCORDANCE WITH THE KANSAS ADMINISTRATIVE REGULATIONS, ARTICLE 12, 82-12-1 TO 82-12-9, INCLUSIVE, ADOPTED PURSUANT TO K.S.A 1982 SUPP. 77-415 et seq.,

EXCEPT:

APPLICANT FURTHER STATES THAT:

WHENEVER PROPOSED LINE IS TO BE LOCATED ON PRIVATE RIGHT-OF-WAY, THE LANDOWNERS LAWFUL CONSENT WILL BE OBTAINED.

INDUCTIVE COORDINATION HAS BEEN OR WILL BE COMPLIED WITH AS RELATED SPECIFICALLY IN K.A.R 82-12-9.

ALL UTILITIES OR RAILROADS LISTED ABOVE HAVE BEEN NOTIFIED IN WRITING (A COPY OF WHICH IS ATTACHED) AS PROVIDED IN K.A.R 82-12-5 AND THAT SUCH NOTICE CONTAINS THE STATEMENT THAT "IF THERE IS ANY OBJECTION TO THE APPLICANT'S PROPOSED LINE CONSTRUCTION, SUCH OBJECTION SHALL BE FORWARDED TO THE STATE CORPORATION COMMISSION WITHIN THE TIME SPECIFIED IN K.A.R 82-12-5 FROM DATE OF NOTICE"

WHEREUPON, APPLICANT REQUESTS THAT THE STATE CORPORATION COMMISSION APPROVE THE OPERATING CHARACTERISTICS, PHYSICAL PROPERTIES AND LOCATION OF SAID PROPOSED LINE, AS HEREINBEFORE DESCRIBED.

DATED AT Topeka, KS , THIS 20 DAY OF 04 2020
CITY, STATE DAY MONTH YEAR

APPLICANT

Evergy Kansas Central, Inc.

Scott Pfeiffer - Technical Specialist Tech Svcs



SIGNATURE AND TITLE OF OFFICER

SERVICES

APPLICANTS IDENTIFICATION AND APPLICATION OF RELATED PAPERS

INSTRUCTIONS

SUBMIT 1 COPY OF APPLICATION

2 COPIES OF MAPS, SCALE NOT LESS THEN 1 INCH PER MILE

PLOTTED _____

COPIES OF ALL NOTICES TO OTHER UTILITIES

COPIES BREAKDOWN OF "COST ESTIMATE" BY UNITS OF PROPERTY ON MAPS PLEASE PROVIDE
LOCATIONS OF EXISTING APPLICANT OWNED LINES IN SUFFICIENT DETAIL TO DETERMINE RELATIVE
LOCATION(S) OF PROPOSED LINE(S).

FOR OFFICE USE ONLY

CHECKED BY

DATE

APPROVED _____

REVISED



4/20/2020

Kansas Corporation Commission
Utility Division
1500 SW Arrowhead Rd,
Topeka, KS 66604

Dear Kansas Corporation Commission :

Attached is an application of , a Evergy Company for approval of plans, specifications and location of a proposed electric line as follows:

Evergy proposes to build a new single-phase overhead line with a single-phase underground line for a new residential property at 19394 Effingham Rd, Valley Falls, KS Jefferson County.
T07S R18E Sec. 34

Work Request# M101118017
Application Sketch# 31899
Pam Finnegan

Also attached is a copy of our letter of notification to all of the other public utilities within one-half (1/2) mile of this proposed Electric Line, together with maps showing the location of the Electric Line.

Any questions concerning this application please contact Pam Finnegan +1 (913) 758-2772 at our Atchison Service Center office, or Scott Pfeiffer - 785-575-6019 , at our general office.

Sincerely,

A handwritten signature in black ink, appearing to read 'Scott Pfeiffer', written over the printed name.

Scott Pfeiffer